

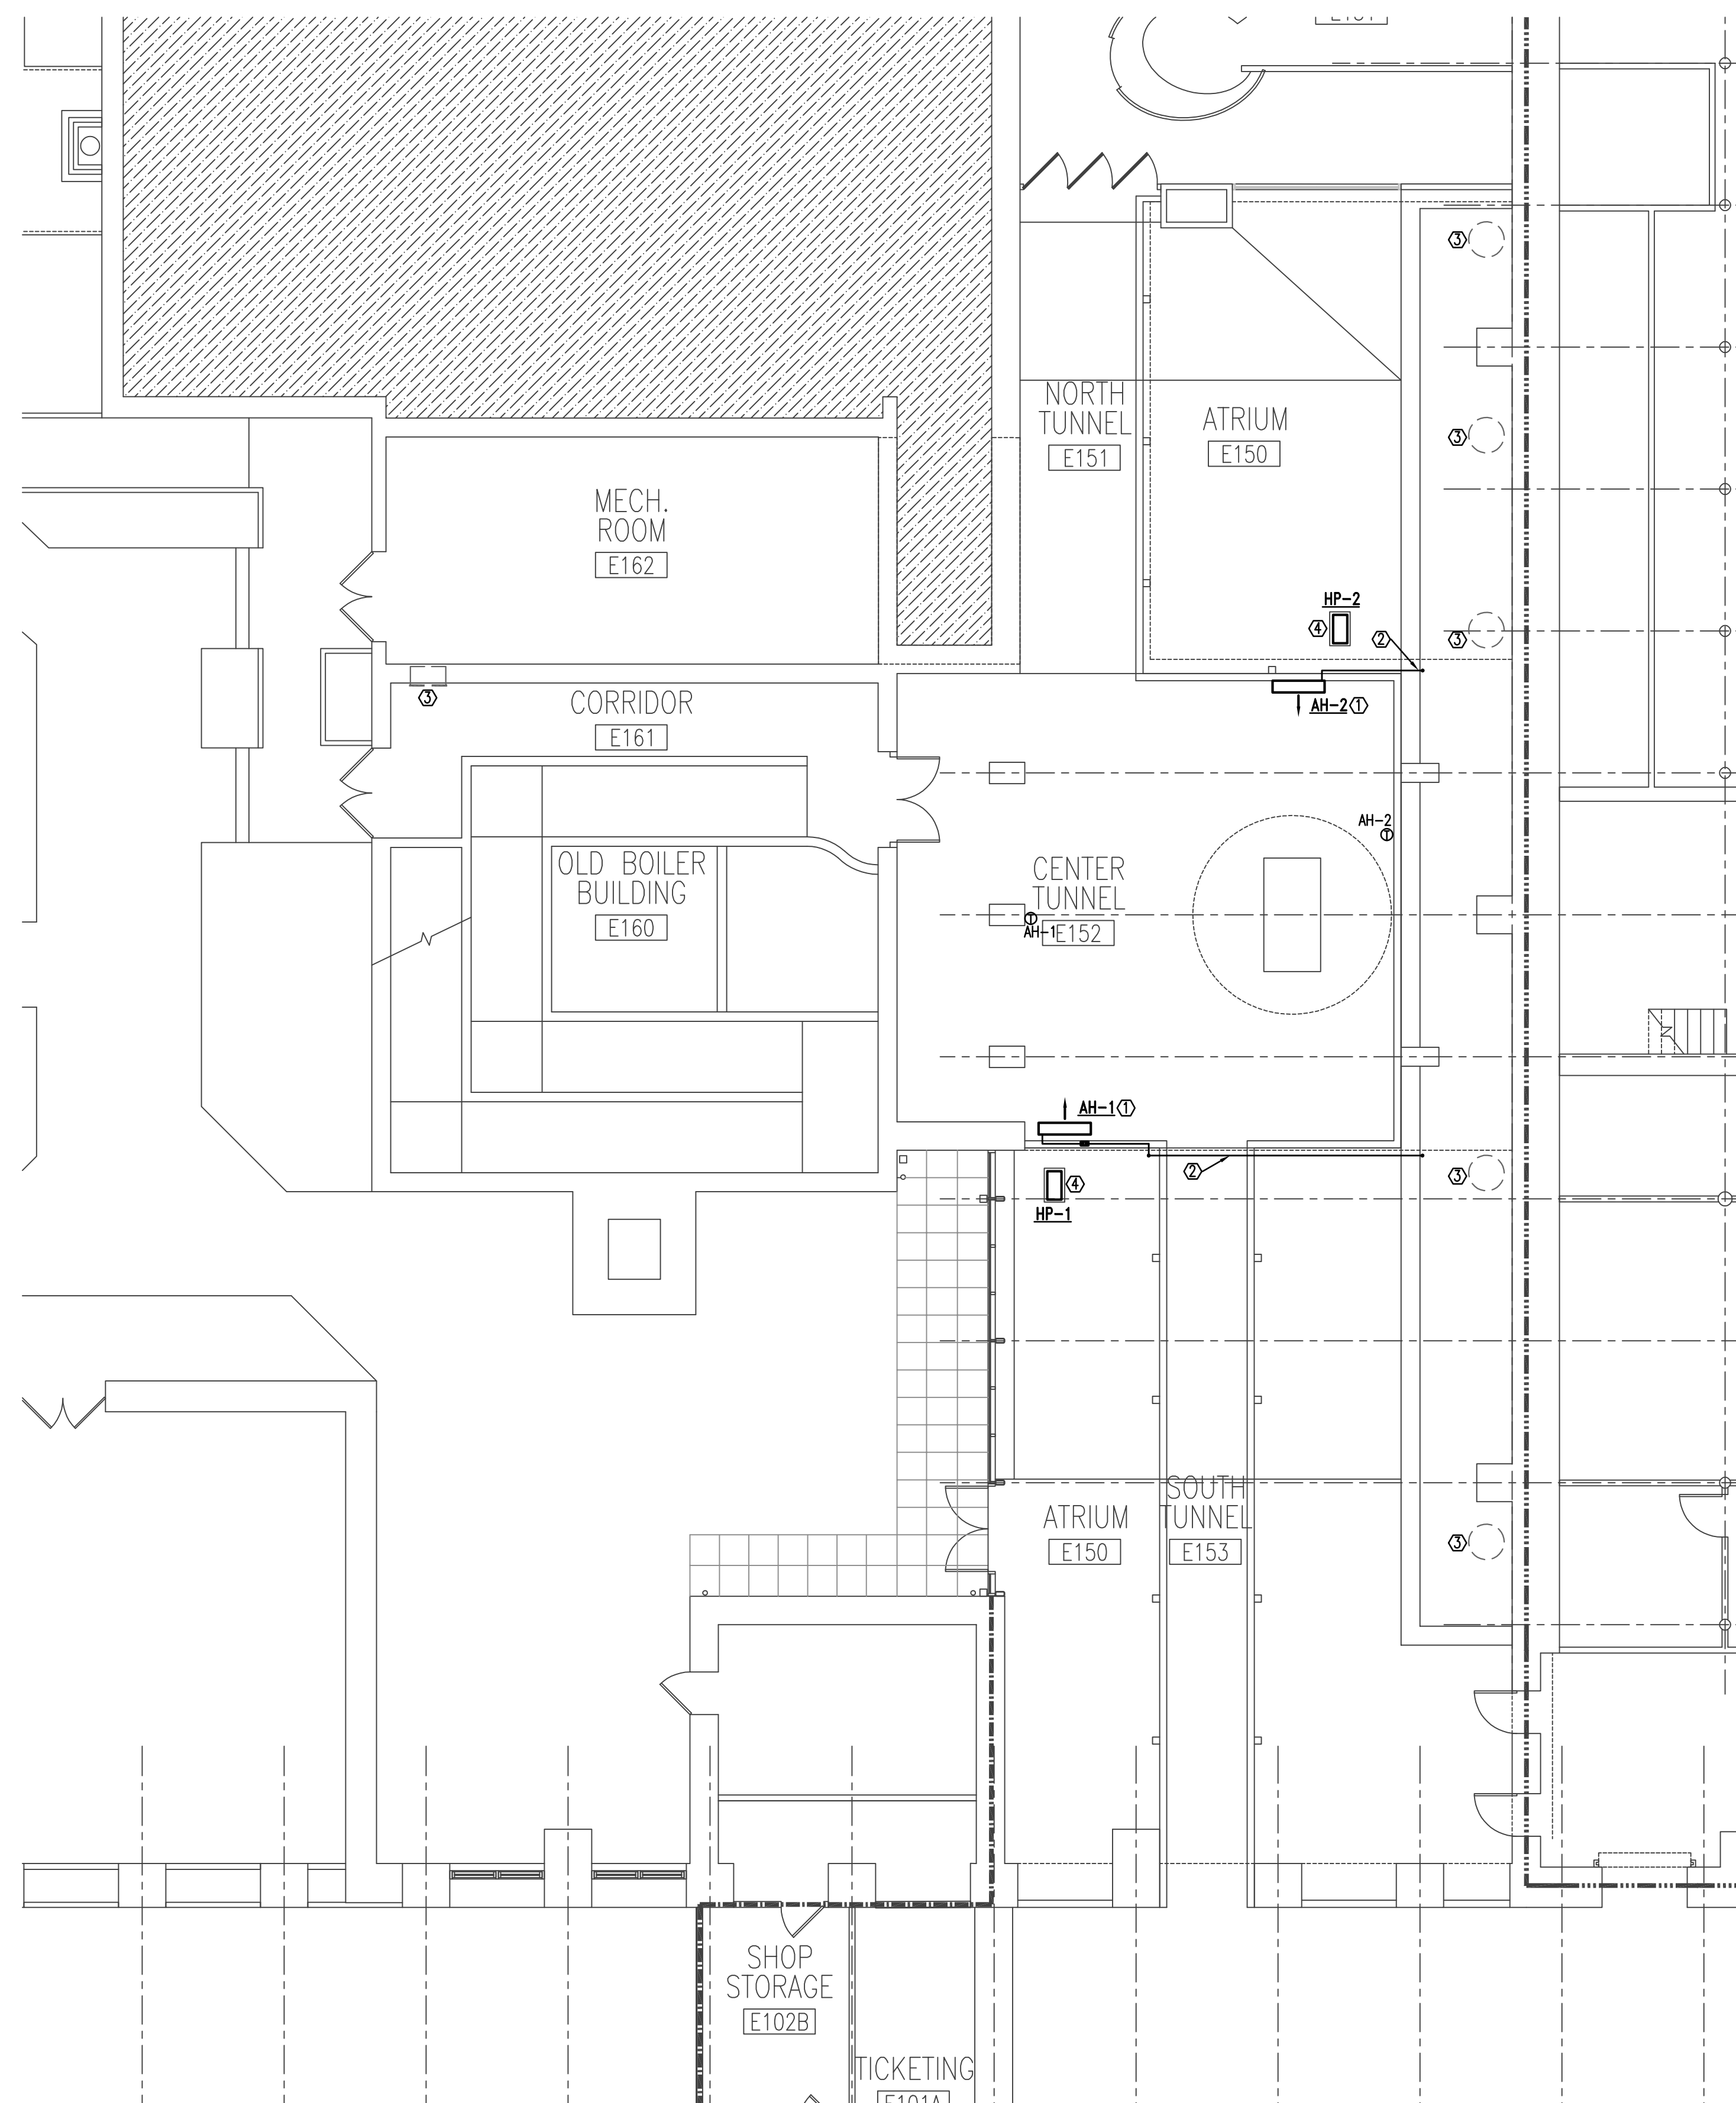



number	item	date

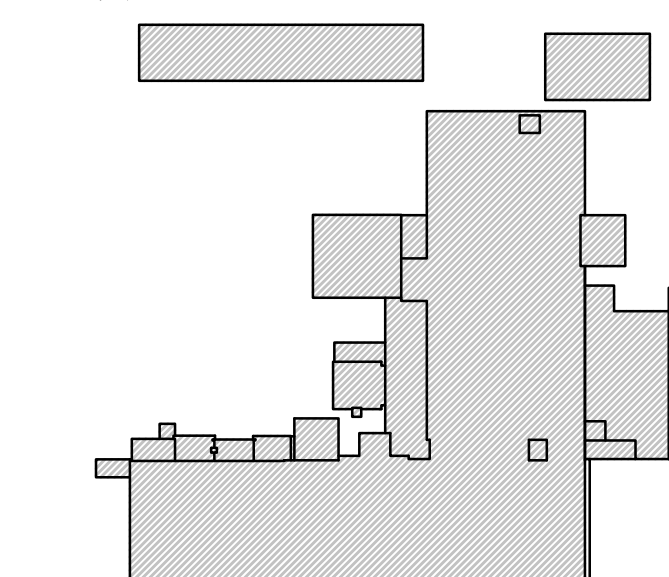

① FIRST FLOOR LEVEL - HVAC RENOVATION
1/8"=1'-0"

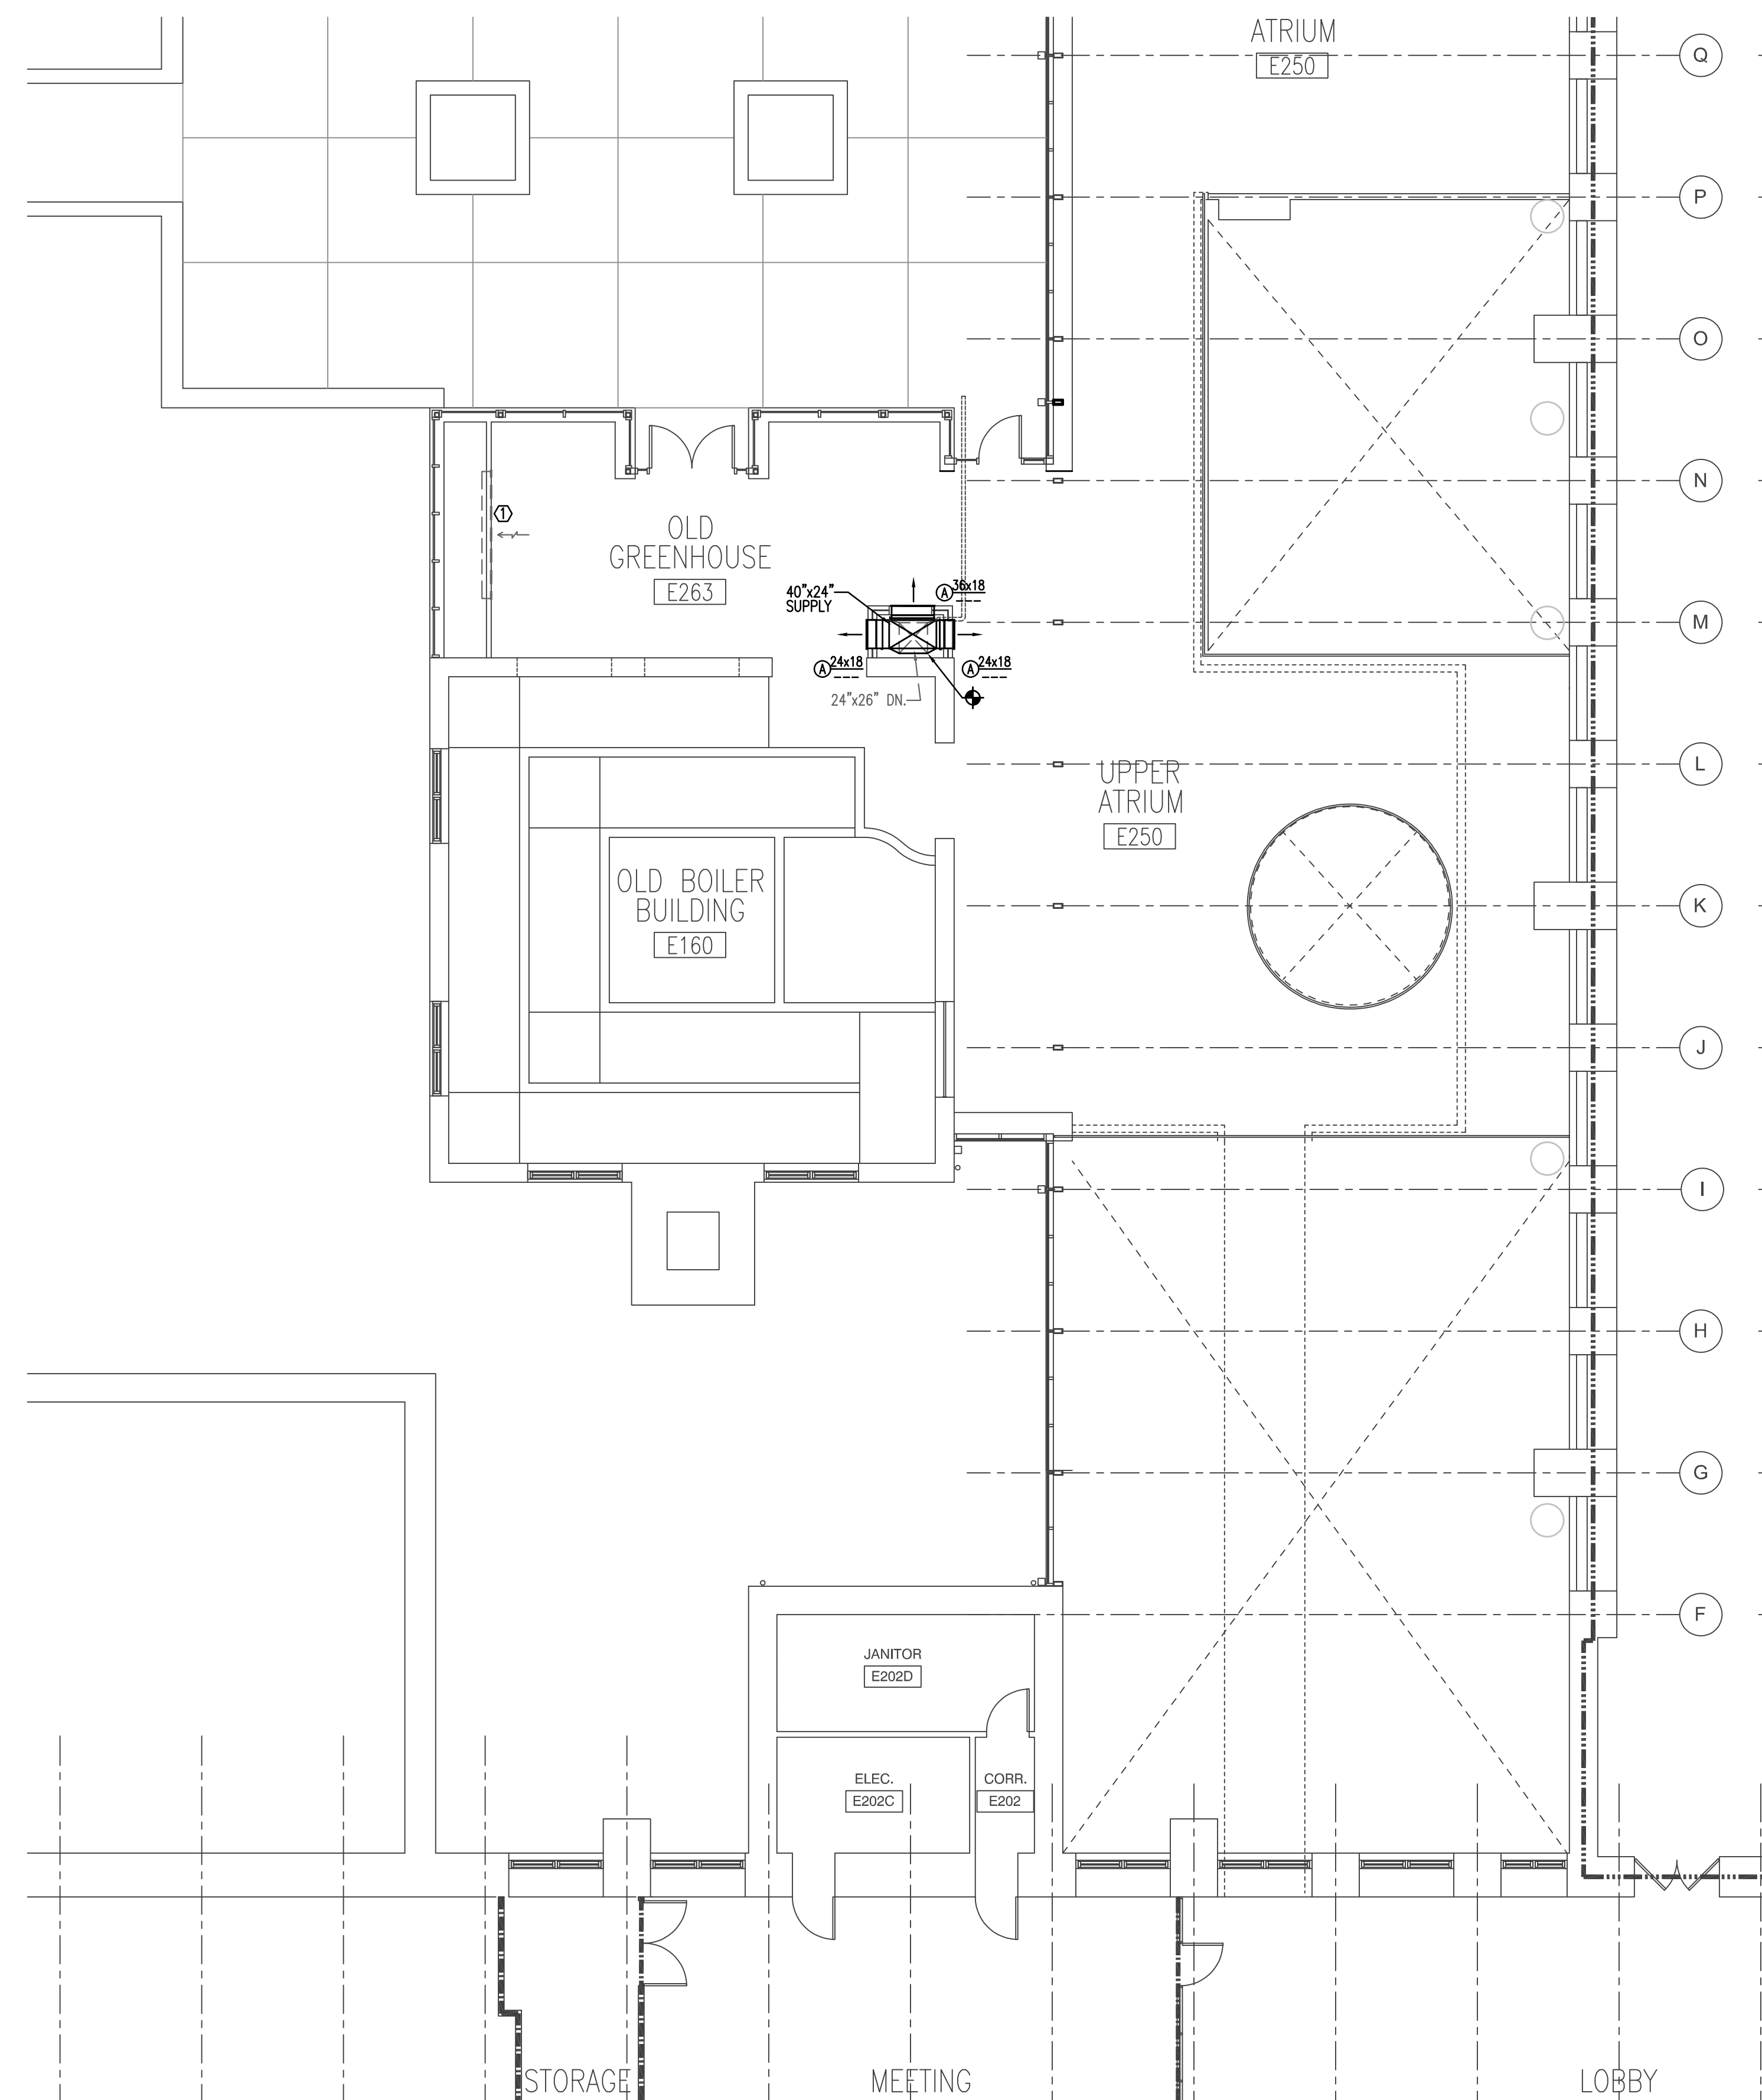

② SECOND FLOOR LEVEL - HVAC RENOVATION
1/8"=1'-0"

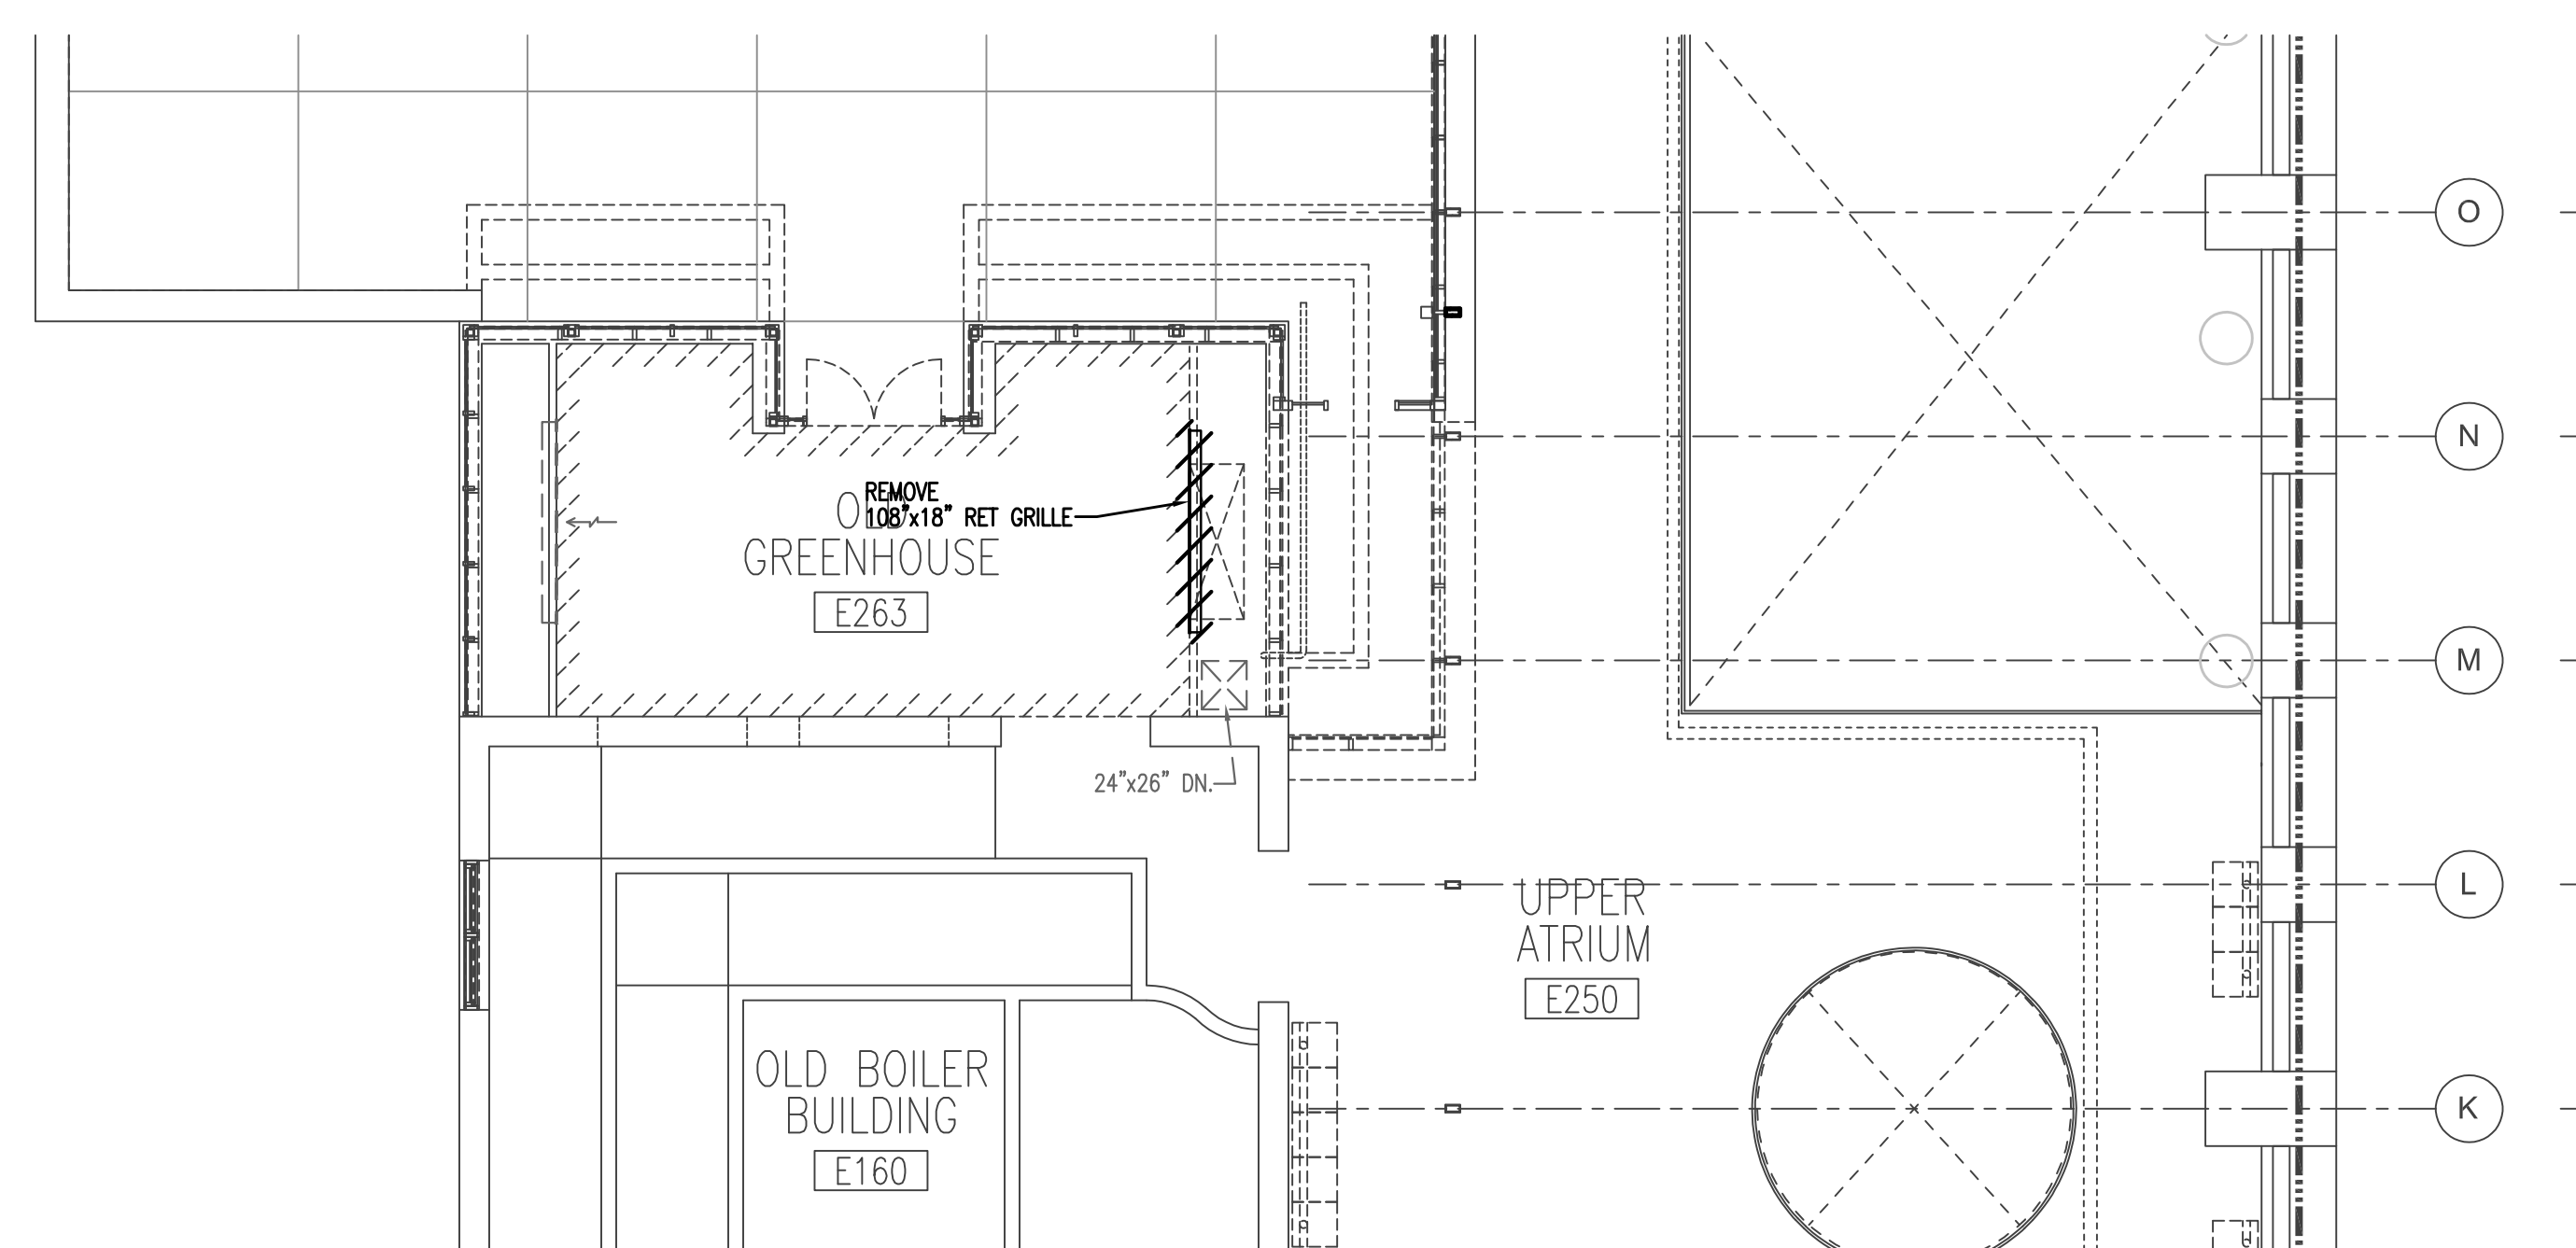

③ SECOND FLOOR LEVEL - HVAC DEMOLITION
1/8"=1'-0"

- RENOVATION KEYNOTES:
- ① ROUTE REFRIGERANT PIPING TO ASSOCIATED CONDENSING UNIT.
 - ② ROUTE 3/4" PVC CONDENSATE DRAIN TO EXISTING PLANTER.
 - ③ COVER AND PROTECT EXISTING SUPPLY/RETURN GRILLE DURING CONSTRUCTION.
 - ④ SET COND UNIT ON PRE-FAB HOUSEKEEPING PAD. UNIT SHALL NOT BE PERMANENTLY FASTENED TO THE FLOOR.

